




MAINS POWERED INTER-CONNECTABLE SMOKE DETECTOR (With 9V Battery Back-up)

ORDER REF: 350.128UK
MODEL: MSD1

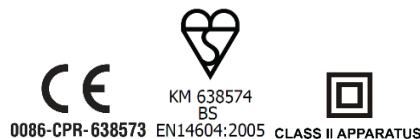

Main Features:

- Photoelectric sensor for slow smouldering fires.
- Large Test/Hush button for easy use.
- Inter-connectable with up to 19 other smoke or carbon alarms, positioned around your property.
- Hush feature which reduces the alarm's sensitivity for a 10-minute period.
- Battery backup and low battery indicator
- Kitemark approved – KM 638574 EN14604:2005 AC/2008
- Supplied with fixing kit, 9V battery and user guide
- Supplied with fixing kit, 9V battery and user guide

This instruction leaflet contains important information on the correct installation and operation of your smoke alarm. Read this leaflet fully before attempting installation and retain for future reference.

SPECIFICATION

Power Source	: 220-240Vac~ 50-60Hz with 9V battery back-up (battery included)
Battery Back-up	: 9V DC Carbon Zinc (Gold Peak 1604E), 9V Alkaline Battery (Energizer 522)
Battery Back-up Life	: In the event of a break in the mains supply the battery will give detector operation for 1 Month minimum
Operation Current	: <40mA operation (In Alarm)
Sensitivity to smoke	: 0.08-0.2db/m
Operation Temperature	: 0°C-40°C
Ambient Humidity	: 10%-90%
Alarm Sound Level	: 85 Decibels at 3 metres
Inter-connect facility	: 20 smoke detectors over 150 metres maximum
Approved to	: BS EN14604:2005

PRODUCT DESCRIPTION

MSD1 is a multiple station photoelectric smoke alarm and can be connected to other alarms of the same make and type. This inter-connect feature allows up to 20 units to be connected over 150 metres maximum distance, using a single wire, and thus allowing all alarms to sound when any one is activated.

Note: This smoke alarm cannot be connected to any other device such as a fire alarm panel.

FIGURE 1 – SINGLE STOREY DWELLING


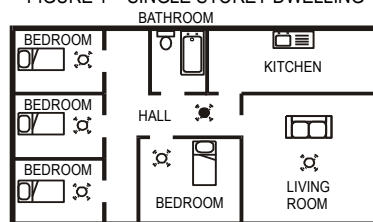


FIGURE 2 – 2/3 STOREY DWELLING

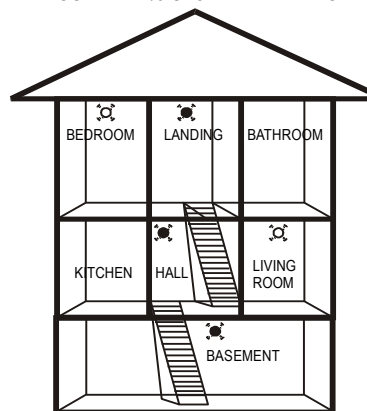

KEY

- ☼ MAXIMUM PROTECTION
- ☼ MINIMUM PROTECTION

All the Smoke Alarms should be inter-connected to ensure the early warning will be heard, particularly by somebody sleeping. A properly designed early warning fire system ensures the alarm is sounded before the escape routes become blocked with smoke.

LOCATING THE SMOKE ALARM

If your dwelling is on a single storey, for minimum protection you should fit an alarm in a corridor or hallway between the sleeping and living areas (incl. Kitchens). Place it as near to the living areas as possible and ensure the audible alarm can be heard when the bedrooms are occupied. See Figure 1 for examples.

If your dwelling is multi-storey, for minimum protection one alarm should be fitted at the bottom of the staircase with further alarms fitted on each upstairs landing. This includes basements but excludes crawl spaces and unfinished attics. See Figure 2 for examples.

NOTE: For maximum protection an alarm should be fitted in every room (except kitchen, bathroom and garage).

DO NOT FIT AN ALARM IN THE KITCHEN OR BATHROOM, as cooking fumes or steam may trigger the alarm.
DO NOT FIT ALARM IN A GARAGE, as exhaust fumes are likely to set it off.

POSITIONING THE SMOKE ALARM

Ceiling Mounting

As hot smoke rises and spreads out, it is advisable to mount on a ceiling in a central position. Avoid areas where there is no air circulation. e.g. corners of rooms and keep away from items which may prevent the free flow of air. Place the unit at least 300mm from any light fitting or decorative object which might obstruct smoke entering the alarm. Also keep at least 300mm away from walls. See Figure 3i (below).


Wall Mounting

Do not mount tight into the corners. Put the top edge of your smoke alarm between 150 and 300mm below the ceiling. Keep at least 300mm from room corners. See Figure 3i (below).

On a Sloping Ceiling

In areas with sloping or peaked ceilings install your Smoke Alarm 900mm from the highest point measured horizontally because "dead air" at the apex may prevent smoke from reaching the unit. See Figure 3ii (below)

Figure 3i- Positioning the smoke / heat detector Figure 3ii

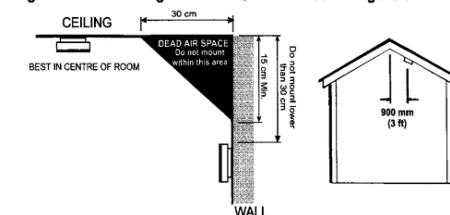

Areas to be avoided include the following :-

- Situations where the temperature may fall below 0°C or rise above 40°C
- Humid areas such as bathrooms, kitchens, shower rooms where the relative humidity may exceed 90%

- Near a decorative object, door, light fitting, window moulding etc., that may prevent smoke from entering the alarm.
- Fume filled environments such as garages. Exhaust gases may cause false alarms.
- Adjacent to or directly above hot components such as radiators or wall vents that can affect the direction of air currents.
- In very dusty or dirty environments such as workshops.
- Locate unit at least 1.5m and route wiring at least 1m away from fluorescent light fittings as electrical "noise" and/or flickering may affect the unit. Do not wire into the same circuit as fluorescent lights or dimmers.
- Do not locate in insect infested areas. Insects and contamination on the alarm sensor can increase its response time.

INSTALLING THE SMOKE ALARM

WARNING – This smoke alarm is mains powered and requires wiring by a qualified electrician in accordance with the current IEE Regulations for Electrical Installations (BS7671).

The circuit used to power the smoke alarm must be a dedicated permanent supply that cannot be switched off accidentally by the normal user. Before installing ensure the electrical supply is isolated.

WARNING : To prevent injury, this smoke alarm must be securely attached to the ceiling/wall in accordance with the installation instructions.

The Smoke Alarm will function correctly either as a stand-alone alarm or inter-connected.

All inter-connected Smoke Alarms must be supplied from a single power circuit.

A common neutral must be used for the inter-connect to function.

Do not connect the Inter-connect wire to Live or Neutral.

- Disconnect the AC main power from the circuit that is going to be used.
- Having established the mounting location install a junction box suitable for locating the termination point. Ensure that there is no other electrical wiring or pipe work in the area adjacent to the mounting surface.
- Unlock the detector unit from the base by pushing back the snap lock with a screw driver and turn the alarm unit anti-clockwise to release it. See Figure 5 and Figure 6.
- Fix mounting plate in position.
- Strip the Live, Neutral and Inter-connect (if used) wires.
- Connect the wires correctly. If the smoke alarms are to be inter-connected, connect the red wire. For Alarm that are used as singularly DO NOT CONNECT THE WHITE WIRE TO ANYTHING. Ensure the screws are fully tightened. See Figure 6.
- The alarm must be wired in accordance with National wiring codes.

LIVE - connect to house wires coloured Brown, Red or marked with L.

NEUTRAL - connect to house wires coloured Blue, Black or marked with N.

INTER-CONNECT - connect to the third wire. If you are not inter-connecting to other units, do not connect any wire to this terminal.

- Insert the 9V battery firmly into battery compartment on the rear of the alarm. NOTE: POLARITY OF CONNECTIONS. Ensure the metal tab is fully depressed when the battery has been fitted.

NOTE – For the safety of the end user, the smoke alarm cannot be used without a battery installed.

- Before fitting to the base plate test the correct operation of the smoke alarm (operating from the battery only) by depressing the test button on the front of the alarm. The unit should emit a loud pulsating alarm.
- Assemble alarm unit onto the mounting plate by turning the alarm unit counter-clockwise. See Figure 4
- Restore the mains supply by plugging the AC QUICK CONNECTOR into the back of the alarm (see Figure 4). Make sure that the locks on the connector snap into place.
- Test the correct operation of the smoke alarm by depressing the test button on the front of the detector. The unit should emit a loud pulsating alarm.
- Please use 2.1mm Ø cable for connection.



Figure 4
Plug the AC QUICK CONNECTOR into the back of the alarm.

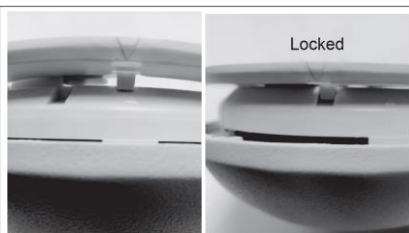


Figure 5
Turn the alarm units clockwise until the snap lock engages.



Figure 6 – Push Back the snap lock and turn the Alarm anti-clockwise

OPERATING YOUR SMOKE ALARM


Once the smoke alarm has been installed a small GREEN indicator light (LED) should be visible through the alarm grill indicating that AC supply is healthy. A RED indicator light (LED) should also flash approximately once a minute to indicate the battery is healthy and the unit is operating properly.

If smoke is detected, the unit will emit a loud pulsating alarm and a RED indicator light (LED) will be flashing quickly at the same time until the air is clear.

TESTING YOUR SMOKE ALARM

It is recommended that you test your smoke alarm once a week to ensure the detector is working correctly. Push and hold the test button for approximately 3 seconds. A loud pulsating alarm should sound and a RED indicator light (LED) will flash at the same time.

NOTE – for multiple inter-connected smoke alarms, only the RED indicator light (LED) of the originating unit will flash rapidly. All other units in the inter-connect system will sound an alarm but their RED indicator light (LED) will NOT flash. Test each alarm checking that the alarm is triggered on all other alarms installed.

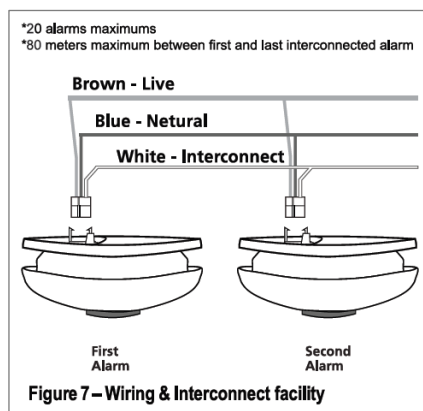

HUSH OR SILENCE FEATURE

This Smoke Alarm has a built-in Hush or Silence feature incorporated into the Test button. If cooking or other non-hazardous sources cause an unwanted alarm, it can be temporarily silenced by depressing the test button and holding for approximately 3 seconds. The alarm will enter a dormant period for 10 minutes. The red LED will flash every 10 seconds to indicate the sensitivity is reduced. At the end of the hush period the alarm will reset to normal sensitivity.

NOTE – If the smoke density increases during this period (i.e. from a fire) the unit will go into alarm mode.

LOW BATTERY WARNING

If the smoke alarm emits a short 'beep' once a minute the battery is at the end of its life and should be replaced immediately. This low voltage warning will be given for at least 30 days. In this case, the other inter-connected units in the system which are not in low battery condition will chirp for a few seconds once an hour as long as the detector with the "dead" battery continues to beep.

If the red indicator light (LED) does not flash every minute then replace the battery.

MAINTAINING YOUR SMOKE ALARM

Clean your smoke alarm at least once every six months to prevent dust build up. This can be done using a vacuum cleaner with the brush attachment. Clean gently around the front grilled section and sides.

The apparatus should not be exposed to dripping or splashing and no objects filled with liquids, such as cups or vases, should be placed on the apparatus.

BATTERY REPLACEMENT

Always TURN OFF the A.C. supply to the Smoke Alarm before replacing the battery. Replace the battery at least once annually, or immediately when the low battery signal sounds once a minute, even though the Smoke Alarm is receiving mains power.

Note - Test the alarm for correct operation using the test facility whenever the battery is replaced.

WARNING: DANGER OF EXPLOSION IF BATTERY IS INCORRECTLY REPLACED. THE USE OF BATTERIES OTHER THAN THOSE RECOMMENDED ON THE BACK OF THE UNIT MAY BE DETRIMENTAL TO ITS OPERATION

The battery should only be replaced by a qualified electrician or similarly qualified person.

- Turn off the mains power supply to the Smoke Alarm.
- Gently unlock the detector unit from the base by pushing back the snap lock with a screw driver and turning the alarm unit clockwise to release it. See Figure 5 and Figure 6.
- Remove the battery from the compartment.
- Insert a new, healthy 9V battery. NOTE POLARITY OF CONNECTIONS. Ensure the metal tab is fully depressed when the battery has been fitted
- Using the Push-to-Test button, test the smoke alarm to verify 9V DC battery back-up. See "TESTING YOUR SMOKE ALARM"
- Reattach the Smoke alarm to the mounting plate by rotating the alarm unit counter-clockwise until it snaps into place. (see Figure 4)
- Turn on the mains power and test the Smoke Alarm using the Push-to-Test button. See "TESTING YOUR SMOKE ALARM"

IMPORTANT SAFEGUARDS

Installation of your smoke alarm is only one step in your safety plan. Other important steps should be taken to further improve your safety:-

- Install the smoke alarm properly, following this instruction leaflet
- Test your smoke alarm weekly
- Replace the battery immediately once depleted
- Do not smoke in bed
- Keep matches & lighters away from children
- Store flammable materials in a proper manner and never use them near naked flames or sparks
- Maintain emergency equipment such as Fire Extinguishers, escape ladders etc and ensure all occupants know how to use them correctly.

- Plan an escape route/s from your building in advance and ensure all occupants are aware of them. Re-enforce this awareness periodically throughout the year.
- Make sure escape routes remain free of any obstructions.

WARNING: IF THERE IS ANY QUESTION AS TO THE CAUSE OF AN ALARM IT SHOULD BE ASSUMED THAT THE ALARM IS DUE TO AN ACTUAL FIRE AND THE DWELLING SHOULD BE EVACUATED IMMEDIATELY.

THIS PRODUCT IS A SEALED UNIT AND CANNOT BE REPAIRED – IF THE UNIT IS TAMPERED WITH IT WILL INVALIDATE THE WARRANTY. IF THE UNIT IS FAULTY PLEASE RETURN IT TO YOUR ORIGINAL SUPPLIER WITH YOUR PROOF OF PURCHASE.

YOUR SMOKE ALARM WARRANTY

These smoke alarms are guaranteed to be free from defects in materials and workmanship under normal use and service for a period of five years from date of purchase. The company will not be obligated to repair or replace parts which are found to need repair because of misuse, damage or alterations occurring after the date of purchase. Send the Smoke Alarm with proof of purchase, postage and return postage prepaid, to your local distributor. The liability of the company arising from the sale of this smoke alarm shall not in any case exceed the cost of replacement of the smoke alarm and in no case shall the company be liable for consequential loss or damages resulting from the failure of the smoke alarm.

AVSL GROUP LTD. SHALL HAVE NO LIABILITY FOR ANY PERSONAL INJURY OR PROPERTY DAMAGE, OR ANY SPECIAL INCIDENTAL, CONTINGENT OR CONSEQUENTIAL DAMAGE OF ANY KIND RESULTING FROM A FIRE. THE EXCLUSIVE REMEDY FOR BREACH OF THE LIMITED WARRANTY CONTAINED HEREIN IS THE REPAIR OR REPLACEMENT OF THE DETECTIVE PRODUCT AT AVSL GROUP LTD. OPTION. IN NO CASE SHALL AVSL GROUP LTD.'S LIABILITY UNDER ANY OTHER REMEDY PRESCRIBED BY LAW EXCEED THE PURCHASE PRICE. YOUR SMOKE ALARM IS NOT A SUBSTITUTE FOR PROPERTY, DISABILITY, LIFE OR OTHER INSURANCE OF ANY KIND. APPROPRIATE COVERAGE IS YOUR RESPONSIBILITY. CONSULT YOUR INSURANCE AGENT.

This does not affect your statutory rights.

This alarm is suitable for single occupancy private dwellings only and not intended for multi occupancy private dwellings or commercial or industrial dwellings.

Waste electrical products should not be disposed of with normal household waste. Please recycle where facilities exist. Check with your Local Authority or retailer for recycling advice. New regulation will encourage the recycling of Waste from Electrical and Electronic Equipment (European "WEEE Directive" effective August 2005).